

1954

may be required

Next meeting
Wed. 23rd.


SW
NR
JLC

26
25
24

PLAIN
Set
16-26

26
10

PAPERPORT

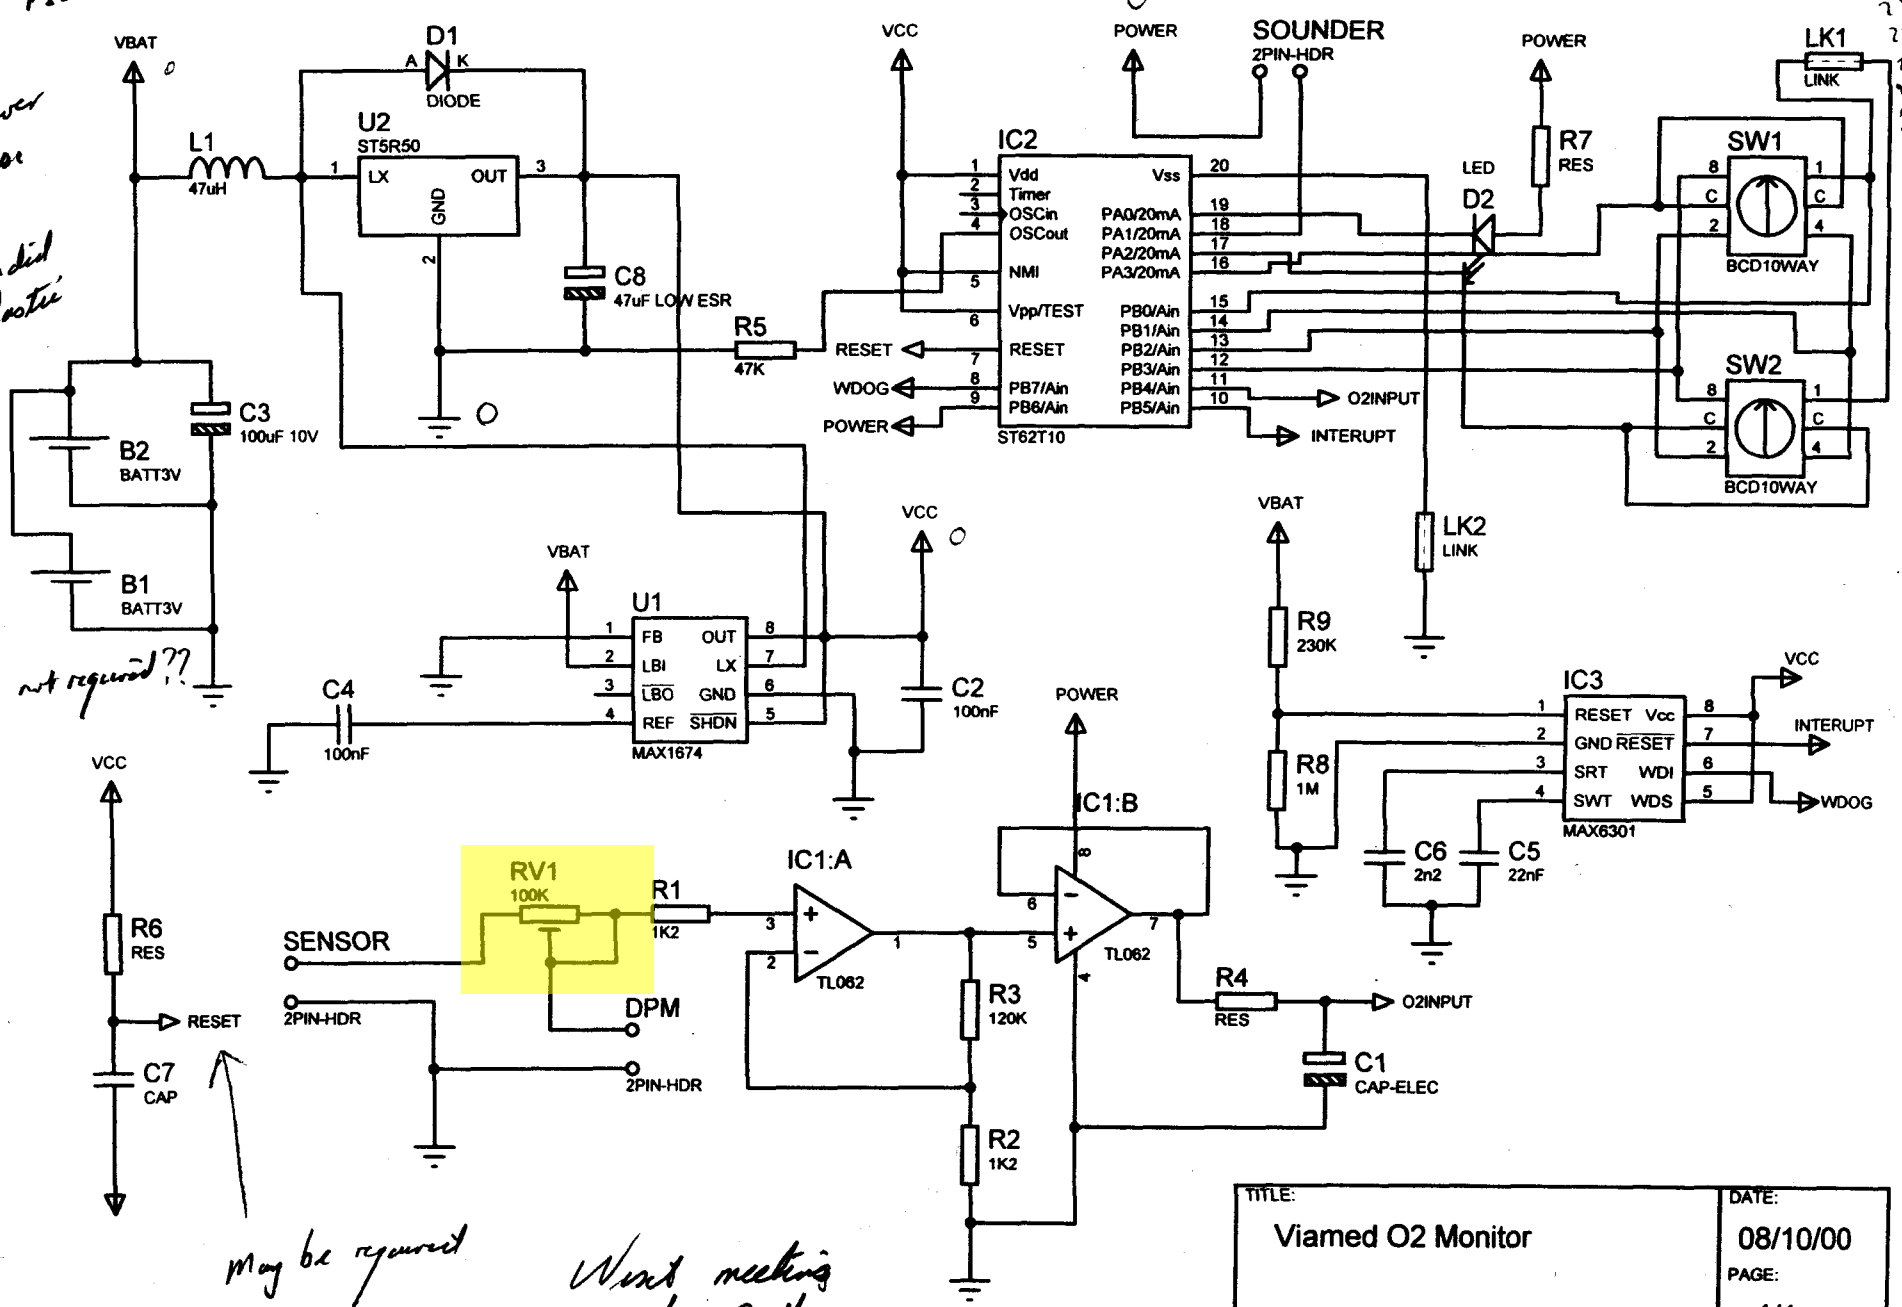

TITLE: Viamed O2 Monitor		DATE: 08/10/00
BY: Neil Rollins	REV: 1	PAGE: 1/1